


Freq	Size	VarCoeff	M5339	M5340
10	3.03	0.34	3.04	3.02
50	7.28	0.11	7.27	7.29
90	14.57	0.19	14.54	14.6

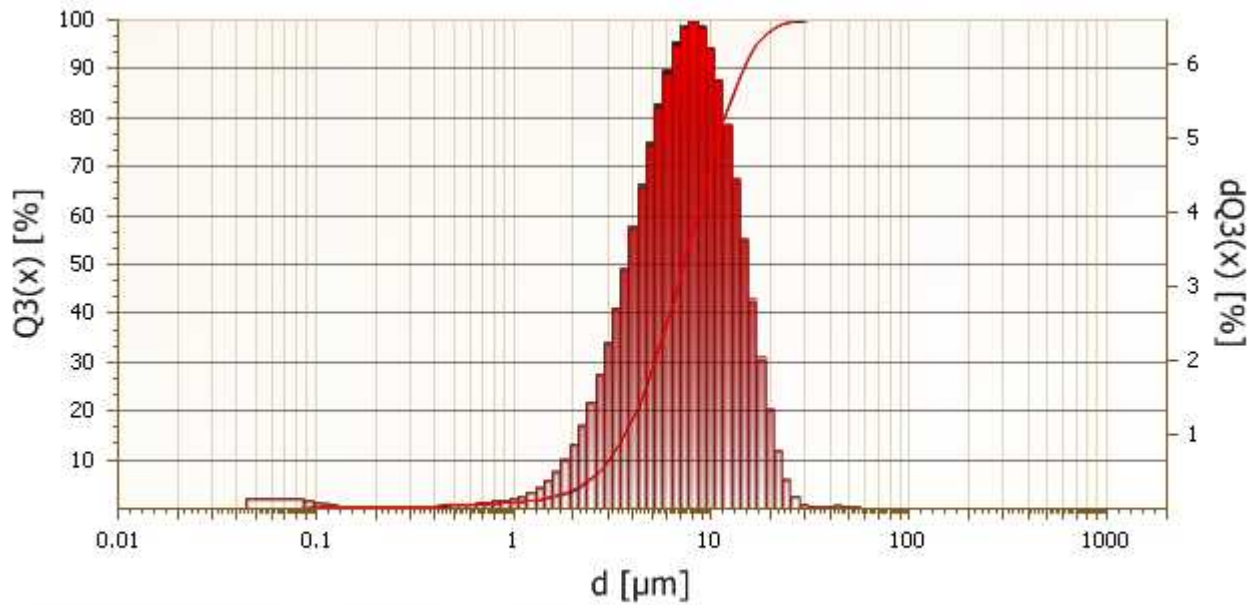

Wolfram HC400

5min p-6 400rpm


090226

Mess.-Nr. 5340 **Datum** Mittwoch, 26 August 2009 02:32 **Bearbeitungs- Nr.:**
Material Wolfram HC400 5min p-6 400rpm **090226**
Bemerkung in Wasser + 0,1% Na4P2O7, 30s Ultraschall

Berechnung Fraunhofer broad **TradeOff** 1.000000e+003
Scans 100 **Scans** 100 **Messkanäle** 102 **Strahlabsorption** 13.00 %
Feinbereich **Grobbereich** **Pumpe** 10 **Ultraschall** 10
Messbereich 0.08 [µm] - 2000.00 [µm]

Freq	Size
5.0	2.23
10.0	3.02
15.0	3.64
20.0	4.19
25.0	4.70
30.0	5.21
40.0	6.22
50.0	7.29
60.0	8.48
70.0	9.91
80.0	11.74
85.0	12.96
90.0	14.60
95.0	17.09
99.0	22.34

Size	Freq
0.10	0.3
0.50	0.7
1.00	1.2
2.00	3.9
5.00	28.0
10.00	70.6
15.00	91.0
20.00	97.9
30.00	99.8
40.00	99.9
50.00	100.0
60.00	100.0
70.00	100.0
80.00	100.0
100.00	100.0

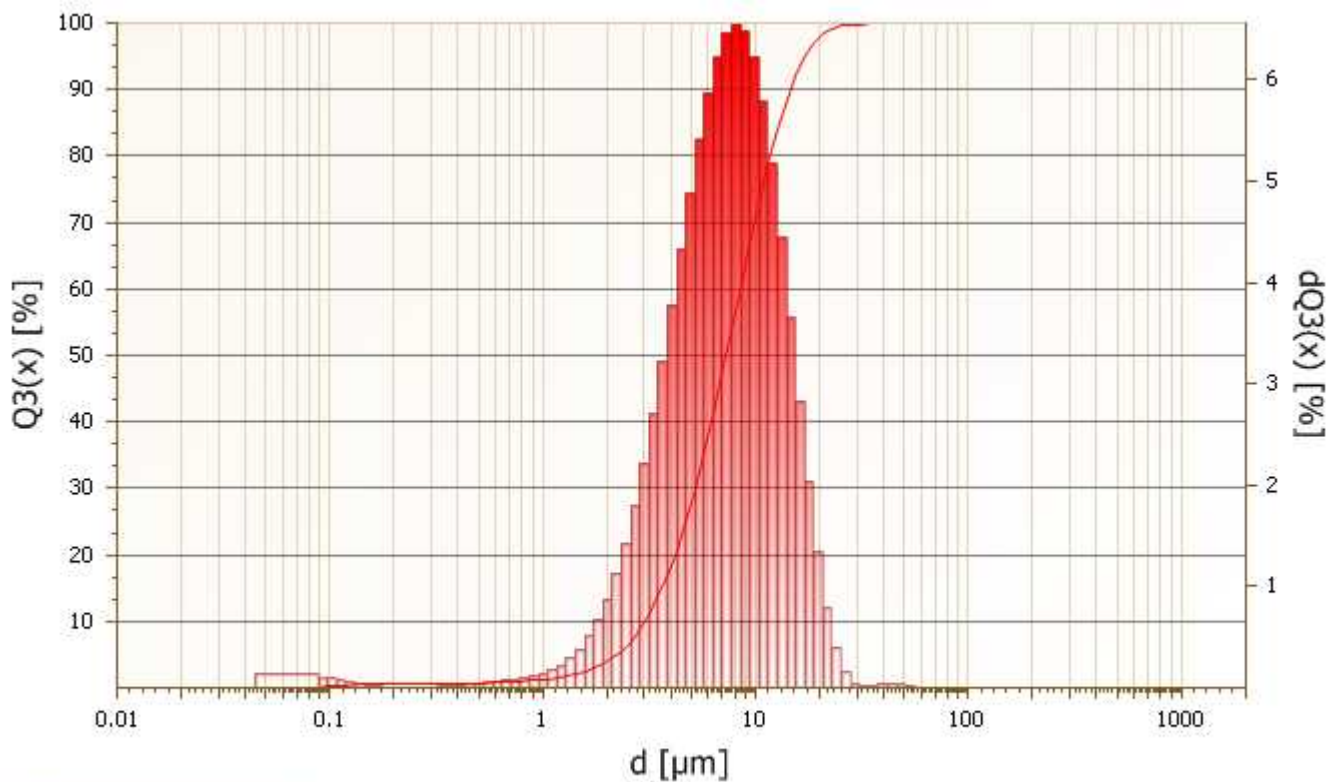

▲ 5340 dQ3(x) — 5340 Q3(x)